


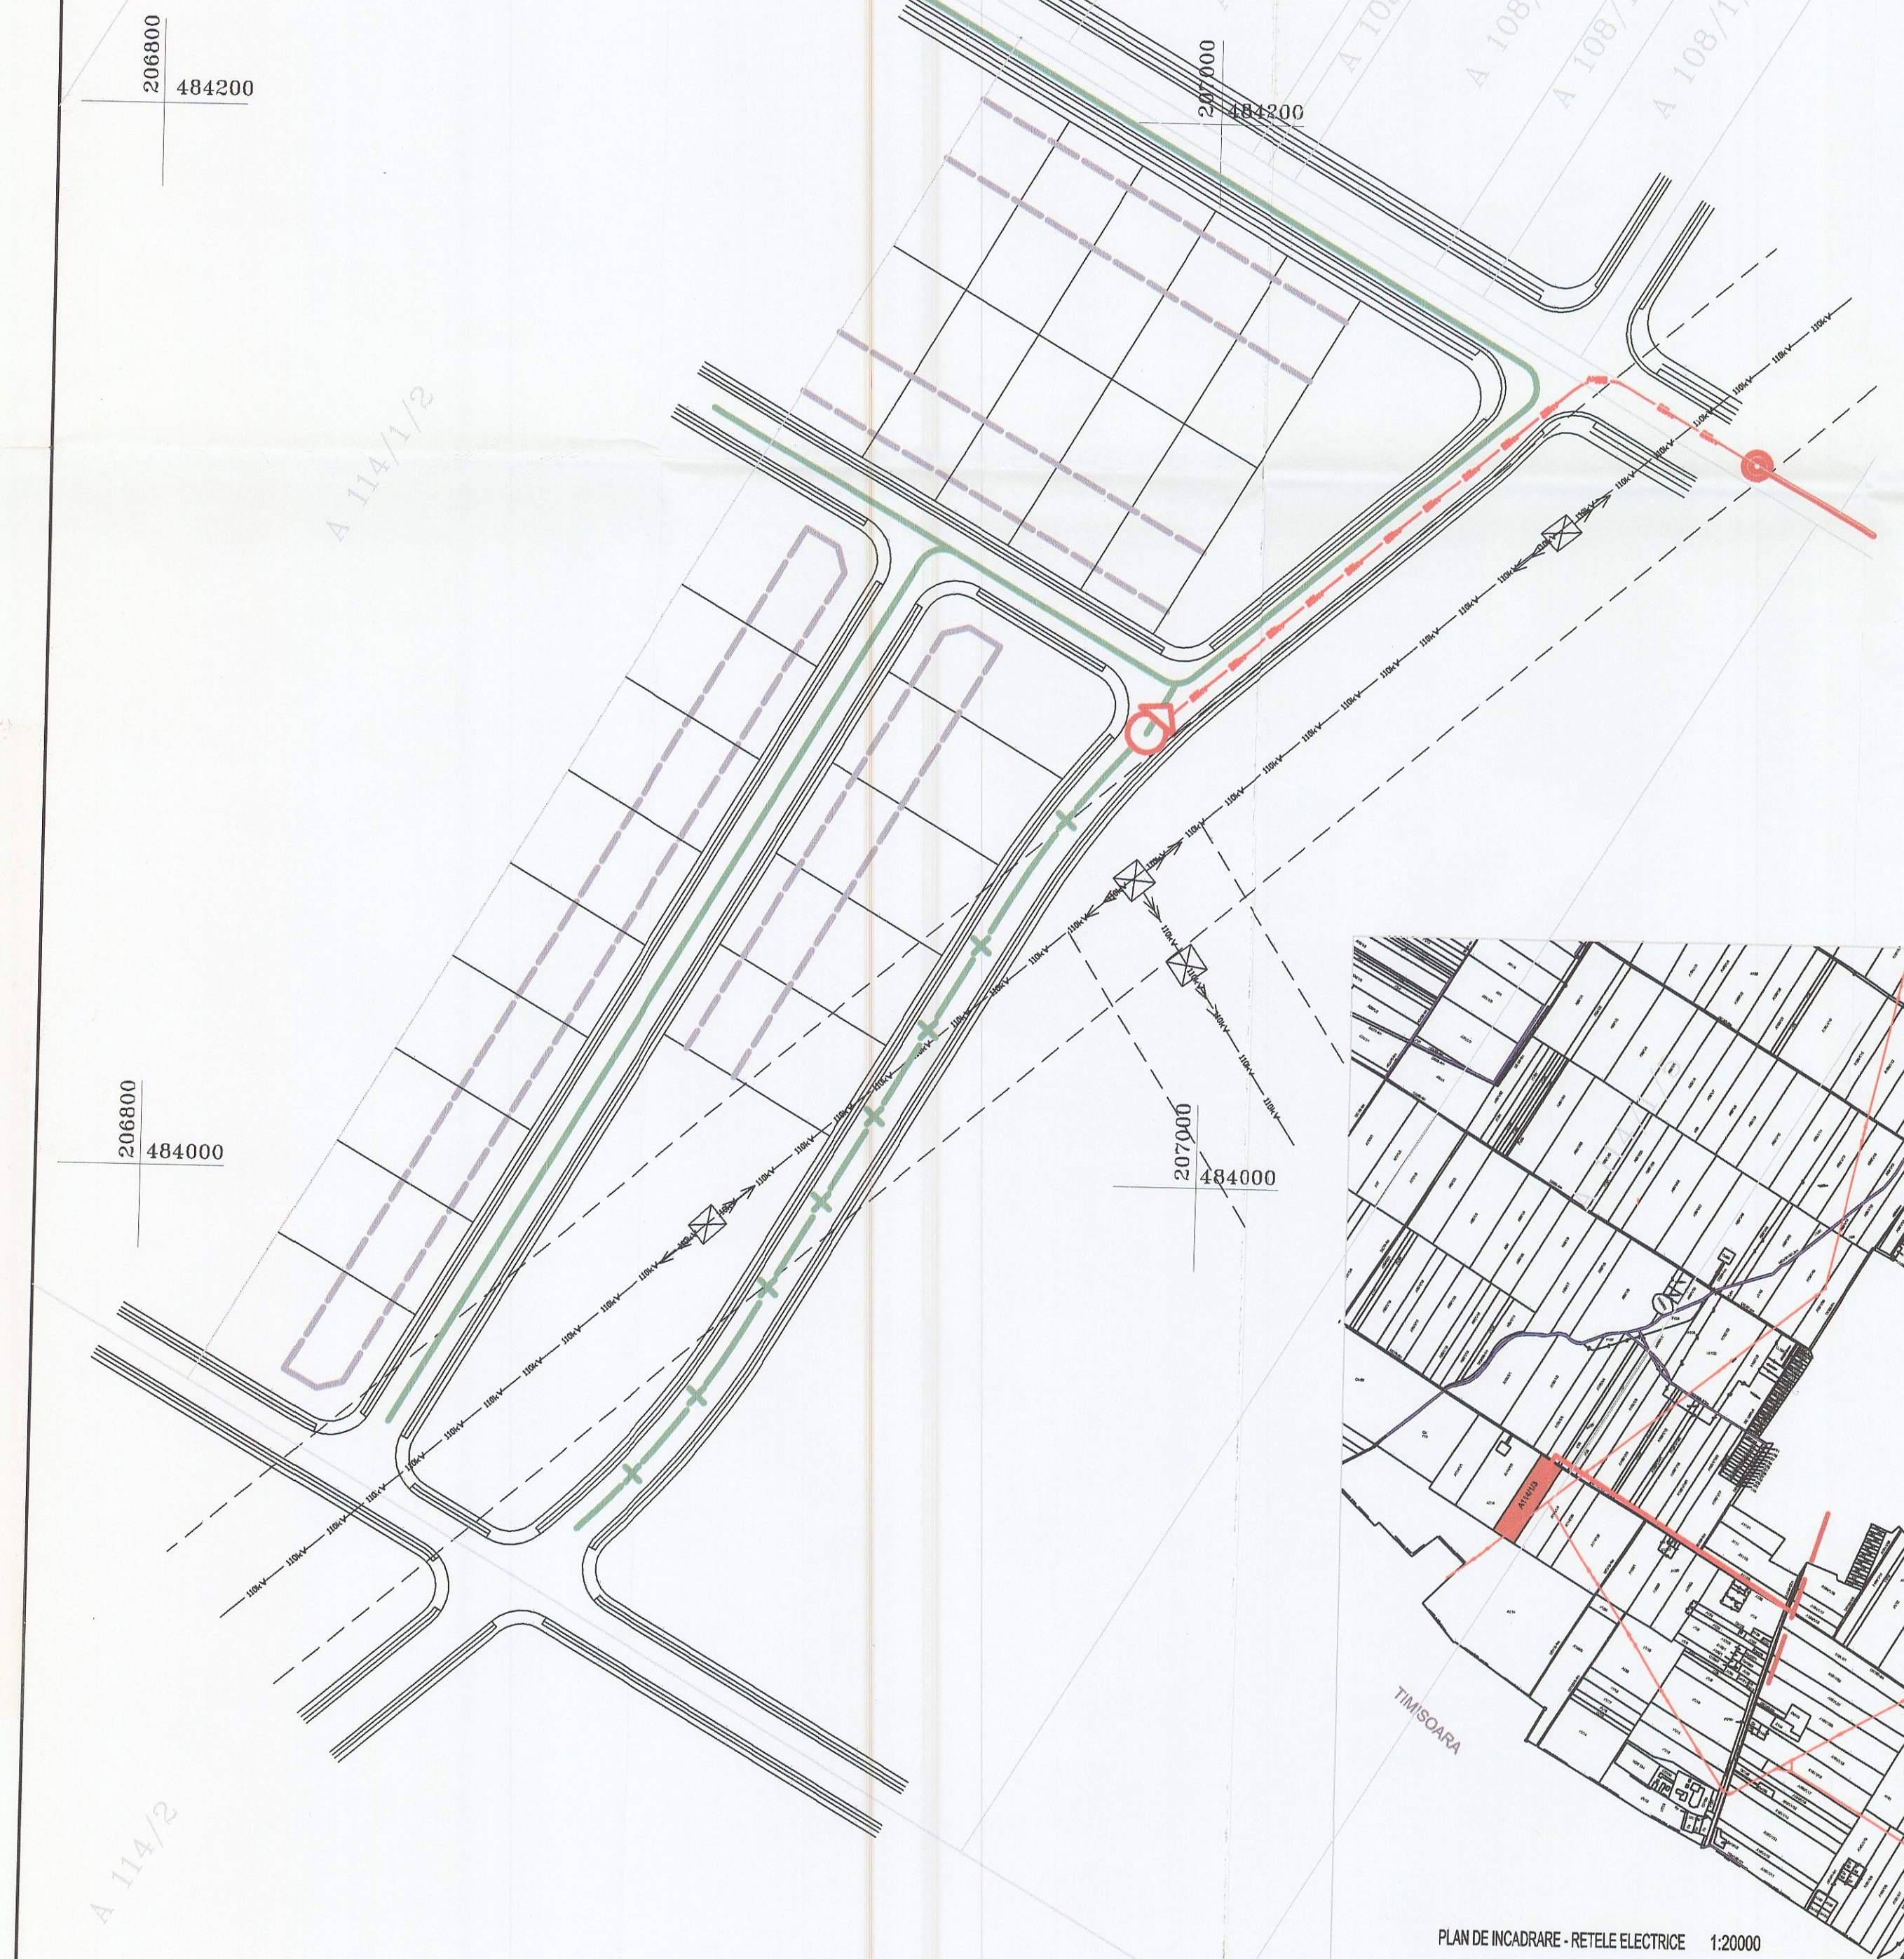

P.U.Z.
LOCUINTE - DUMBRAVITA
EXTRAVILAN

A 114/1/3
PLAN DE SITUATIE - RETELE ELECTRICE

CONSILIUL JUDETEAN TIMIS
VIZAT SPRE NESCHIMBARE
Anexa la aviz CU CONDOP
Nr. 25 din 19.04.2005
Arhitect Sef ctab

LEGENDA

- — — — — LEA 110kV existenta
- — — — — LEA 20kV propusa
- — — — — Cablu subteran 20kV propus
- ⊗ PTZ sau in anvelopa 20/04kV propus
- — — — — LEA j.t. forta si iluminat propusa
- x — x — LES 1 kV pt. iluminat propusa




LEGENDA

- — — — — LEA 20 kV EXISTENTA
- — — — — LEA 20 kV PROPUSA

PLAN DE INCADRARE - RETELE ELECTRICE 1:20000

ORDINUL ARHITECTILOR
DIN ROMANIA
2573
Cristina Janina
BOGDAN
Arhitect
cu drept de semnatura

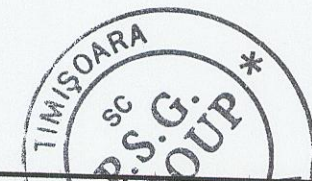

PROIECTANT: S.C. P.S.G. GROUP S.R.L. TIMISOARA	PROIECT: P.U.Z.-LOCUINTE DUMBRAVITA EXTRAVILAN SUD	NR.PR. 259/04
Sef proiect: arh. dipl. Bogdan C.	Scara: 1:1000	Faza: P.U.Z.
Proiectat: ing. Urma I.	Amplasament: A 114/1/3	
Desenat: teh. Jivan M.	Beneficiar: EXTRAVILAN DUMBRAVITA SUD jud. TIMIS	
Aprobat: ing. dipl. Maftei E.	Data: IUN.2004	
	Plansa: PLAN DE SITUATIE RETELE ELECTRICE	Nr.pl. 04